

SUBMITTAL

Part Number
2011827

SUBMITTED TO _____

COMPANY _____

JOB NAME _____


EQUIPMENT _____

SIGNATURE _____

DATE _____


© 2007 COX ENGINEERING DBA CAMBRIDGEPORT AIR SYSTEMS.
THE INFORMATION CONTAINED IN THIS DOCUMENT IS PROPRIETARY TO
COX ENGINEERING COMPANY DBA CAMBRIDGEPORT AIR SYSTEMS.
THIS DOCUMENT OR THE INFORMATION CONTAINED IN WHOLE OR IN PART
MAY NOT BE ISSUED TO ANOTHER PARTY WITHOUT WRITTEN CONSENT AND
AUTHORIZATION FROM CAMBRIDGEPORT.

SUBMITTAL

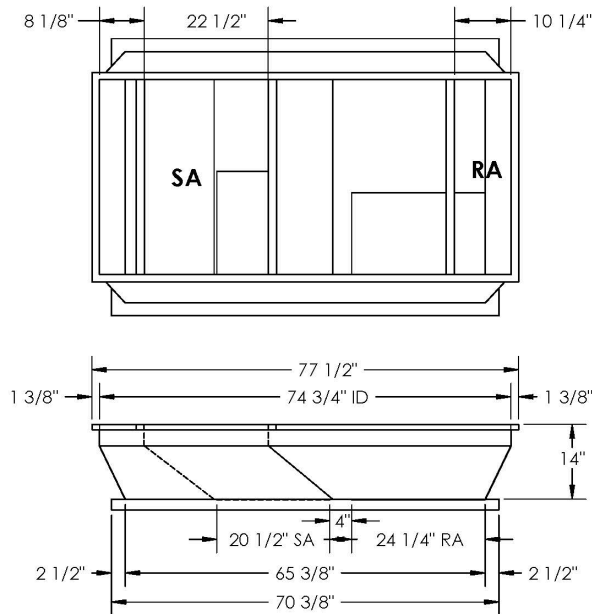

MATERIAL: 18GA.(0.0516) 118.8 LBS.

REVISIONS			
ZONE	REV.	DESCRIPTION	DATE

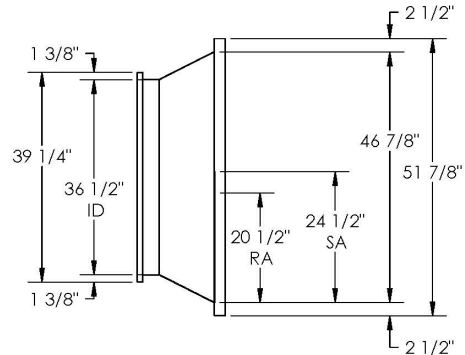

FEATURES:

- ONE PIECE WELDED CONSTRUCTION
- CURB ADAPTER MADE OF HEAVY GAUGE GALVANIZED STEEL.
- ALL WELDS ARE COATED WITH A GALVANIZED COMPOUND.
- GASKETING IS PROVIDED FOR UNIT TO CURB ADAPTER SEALING.
- CURB ADAPTER IS FULLY INSULATED.
- SUPPLY TRANSITION AND RETURN PLENUM INCLUDED.

Approved By: _____

Date: _____

Cambridgeport			
4 CARLETON DRIVE GEORGETOWN, MA 01833			
HVAC Accessories & Engineered Systems			
UNLESS OTHERWISE SPECIFIED:	CUST. NO.	DRAWN	DATE
TOLERANCES:	CUST. NO.	DATE	8/16/13
DECIMALS = ± .003	LENNOX GC516-653	ASS'Y, ADAPTER	
FRACTIONS = ± 1/16	NEW AAO RQ05 STD.		
ANGLES = ± 1°	SUBMITTAL NO.		
MATERIAL CONDITIONS:	2011827		
REMOVE ALL BURRS & SHARP EDGES	DETAIL OF		
ALL DIMENSIONS ARE O.D.	2011827	SHEET 1	OF 1
		PART NO.	2011827
		REV.	

FEATURES

- ONE PIECE WELDED CONSTRUCTION
- FACTORY INSTALLED SUPPLY TRANSITIONS
- FULLY INSULATED
- DESIGNED FOR EVEN WEIGHT DISTRIBUTION
- FABRICATED OF HEAVY GAUGE G90 GALVANIZED STEEL
- ALL WELDS SPRAYED WITH GALVANIZING COMPOUND
- GASKET PROVIDED FOR UNIT TO ADAPTER SEALING

CAMBRIDGEPORT STRONGLY RECOMMENDS CONFIRMING THE DIMENSIONS ON THIS SUBMITTAL

CURB ADAPTERS ARE BASED ON UNIT MANUFACTURERS STANDARD CURB DIMENSIONS.
CAMBRIDGEPORT CANNOT BE RESPONSIBLE FOR ANY DEVIATIONS FROM FACTORY DIMENSIONS OR INCORRECT MODEL NUMBERS.